

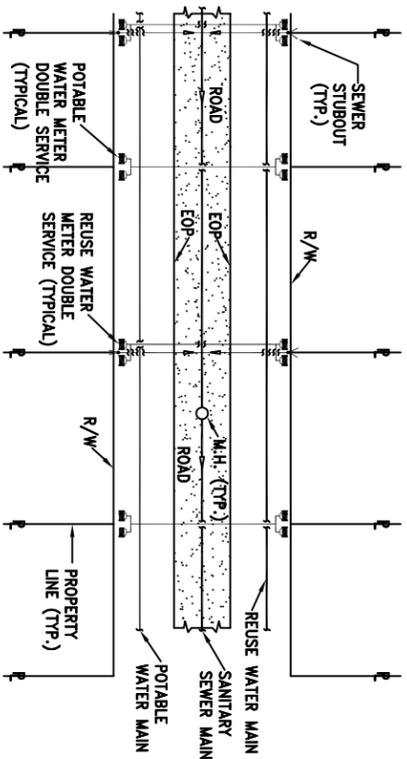


ROADWAY WITH SIDEWALK AND CURB

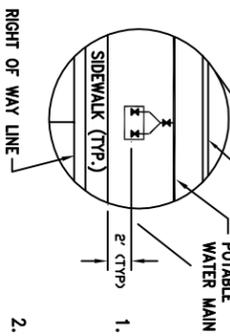


ROADWAY WITHOUT SIDEWALK AND CURB

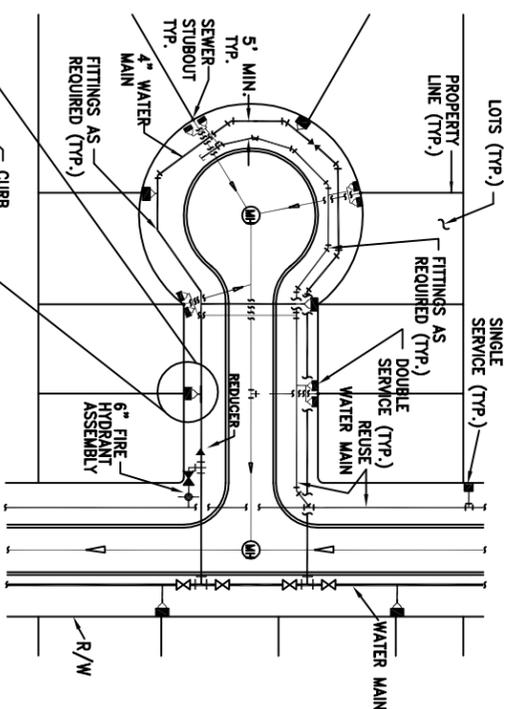


- NOTES:
1. ANCHORING TYPE 90° BEND SHALL ONLY BE USED WHERE RIGHT-OF-WAY RESTRICTIONS WILL NOT ALLOW INSTALLATION OF A STRAIGHT ASSEMBLY.
 2. PROVIDE DIAGONAL SERVICE LINES WHERE PROPERTY LINES DO NOT LINE UP.
 3. PROVIDE GPS ID MARKERS AT HYDRANTS, VALVES AND AIR RELEASE VALVES.
 4. PROVIDE PLASTIC MARKERS AT METER SERVICES


POTABLE WATER SERVICE LOCATION DETAIL

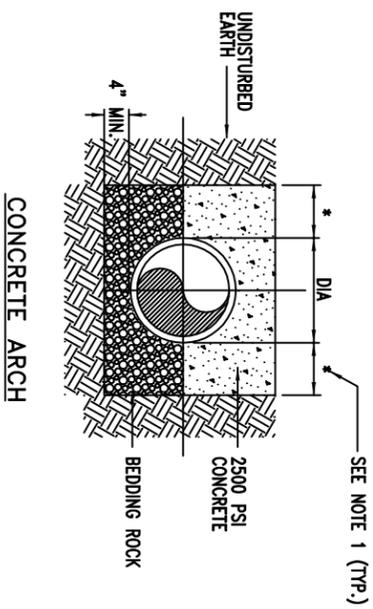


CONCRETE ARCH

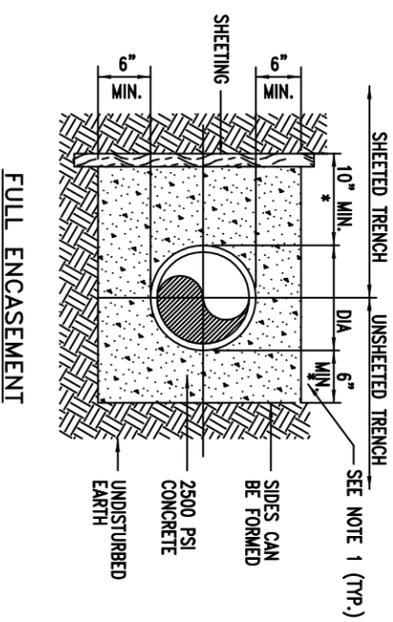

FULL ENCASUREMENT

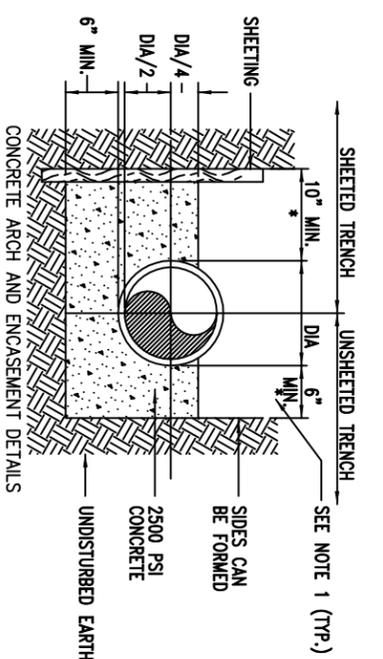

CRADLE OR HALF ENCASUREMENT

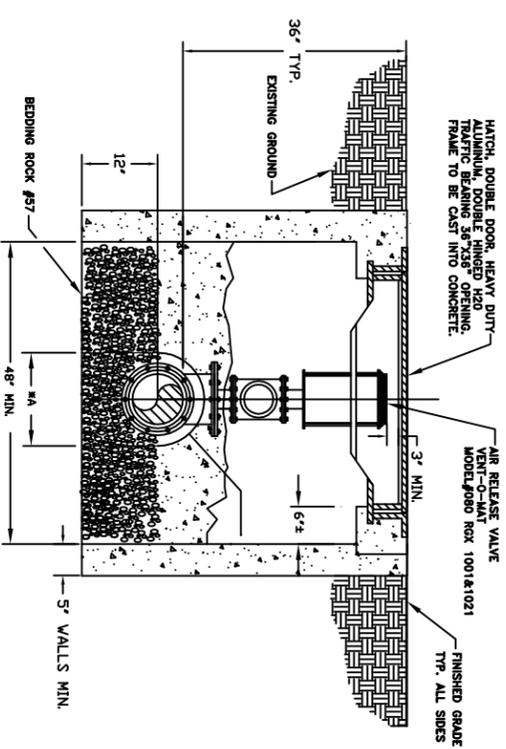

POTABLE WATER AIR RELEASE VALVE

- NOTES:
1. (4): 15" MAX. FOR PIPE DIAMETER LESS THAN 24", AND 24" MAX. FOR PIPE DIA. 24" AND OVER.
 2. USE OF CONCRETE ARCH HALF ENCASMENT OR FULL ENCASMENT TO BE DETERMINED IN THE FIELD AS DIRECTED BY THE COUNTY.
 3. REFER TO THE MANUAL FOR SHEETING AND BRACING EXCAVATIONS.



CITY OF LAKE WALES

ISSUE CODE	A	PRELIMINARY	B	DESIGN	
C	BIDS	D	CONSTRUCTION	E	APPROVAL
DESIGN:	SCALE:	N.T.S.			
CHK'D BY:	DATE:	ENGR. APPR.			
DRAWING TITLE	METER LOCATION AND ENCASMENT DETAILS				
JOB NO.					
AREA	CITY-OF-LAKE-WALES				
REV.					

ISSUE CODE